


GROUND TYPE	NEGATIVE	RECOMMENDED TEST LEAD	TB-8S, TB-8C OR TB-53C
ALTERNATOR TYPE	2 (INTERNAL REGULATOR)	UNIVERSAL TEST LEAD	TB-SP2
FIELD CIRCUIT	"B"	BY-PASS DIODE TRIO	N/A
FIELD SOURCE	RECTIFIER POSITIVE	BY-PASS REGULATOR	N/A
"NO CHARGE" LIGHT	TEST LEAD LIGHT	AUX. VOLT METER	1/2 OUTPUT VOLTS

REGULATOR #'S 1116411, 425, 427, 429, 437, 443

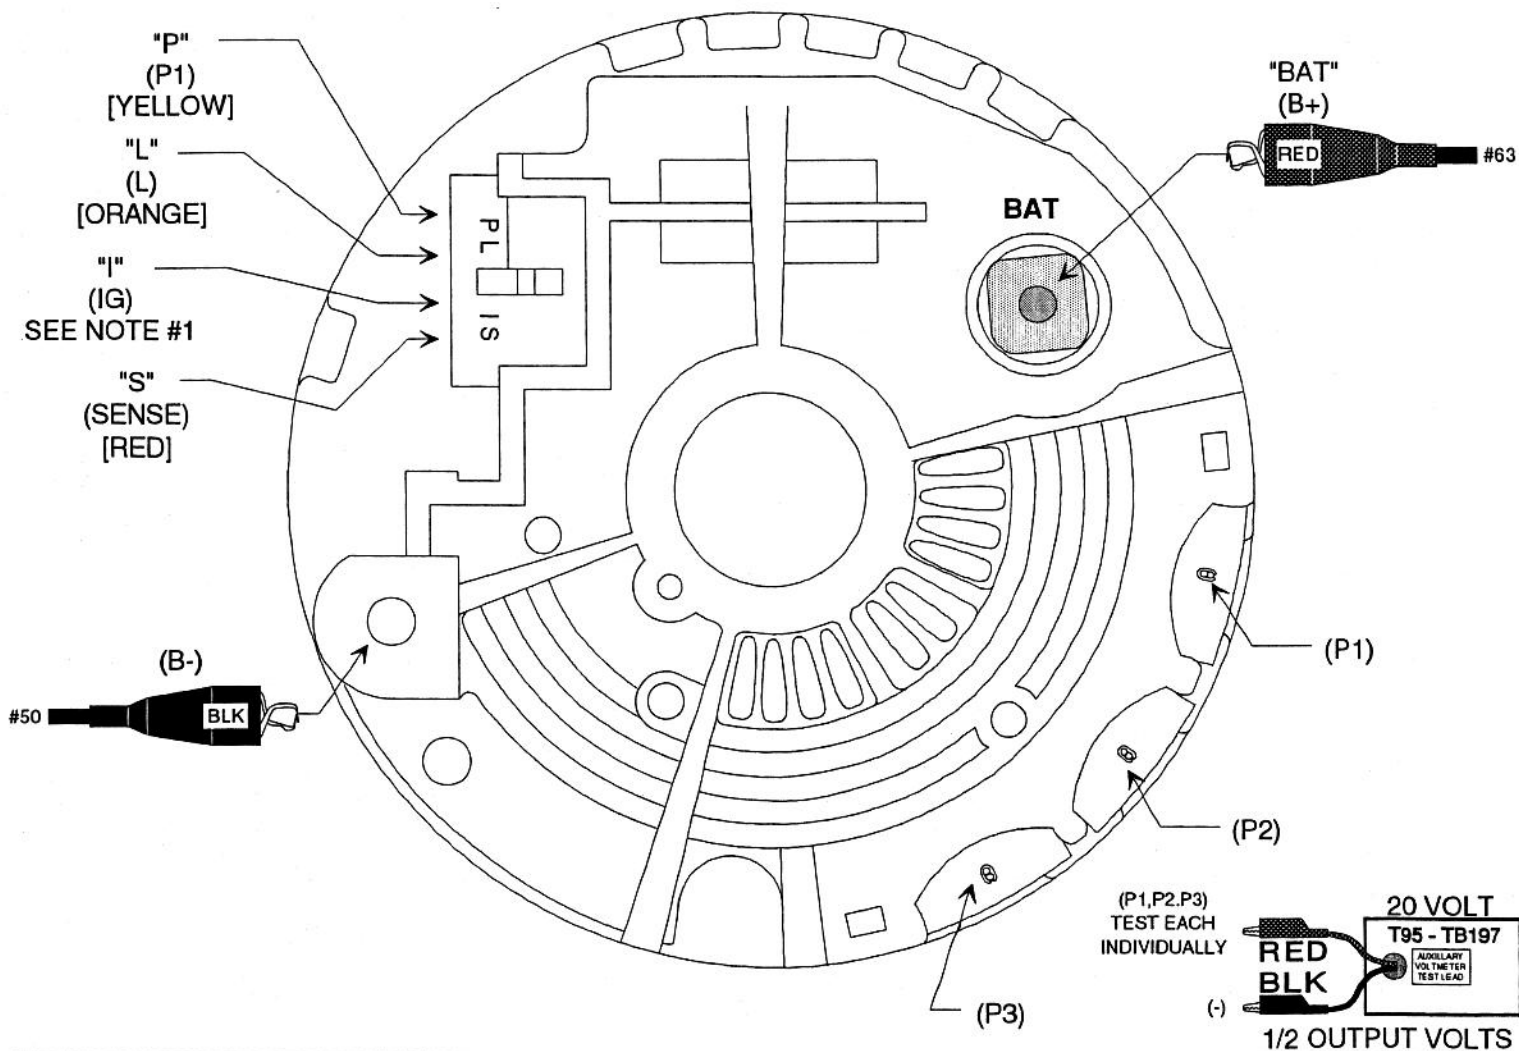

NOTES:

1. WHEN USING TB-8S AND TB-SP2 TEST LEADS, THE "I" TERMINAL IS NOT TESTED. WHEN USING TB-8C OR TB-53C (FULL FUNCTION TEST LEAD), THE "I" TERMINAL IS VERIFIED.
2. PLASTIC COVER NOT SHOWN

DELCO REMY CS SERIES "P-L-I-S"
WITH REGULATOR #'S 1116411, 425, 427, 429, 437, 443

